

Report No.:

Test Time: 2023-07-12 08:04

Luminaire Property

Luminaire Manufacturer:

Lamp Catalog: LED

Luminous Width (mm): 100

Voltage: 119.9 V

Power: 19.82 W

Luminous Length (mm): 600

Luminous Height (mm): 30

Current: 0.169 A

Power Factor: 0.980

Photometric Results

CIE Class: Direct

Measurement Flux: 2842 lm

Downward Ratio: 94%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 206.5, 160.9, 185.5, 184.2

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 125.0, 105.7, 115.0, 114.5

Luminaire Efficacy Rating (LER): 143.44

Max. Intensity: 859.52 cd

S/MH(C0/C180): 1.29

Total Rated Lamp Lumens: 2842.0 lm

Efficiency: 100%

Upward Ratio: 6%

Central Intensity: 859.14 cd


Pos of Max. Intensity: H30 V2

S/MH(C90/C270): 1.21

Picture Of Luminaire



Luminous Intensity Distribution Curve

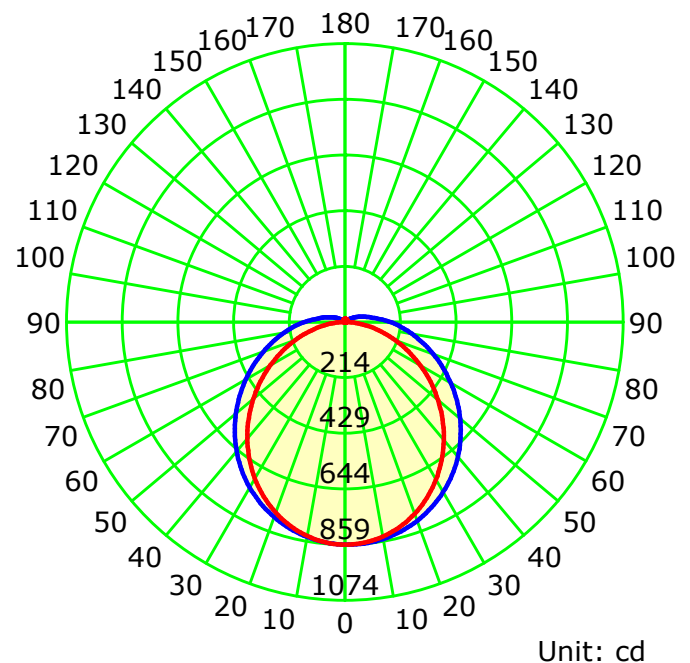

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0



Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

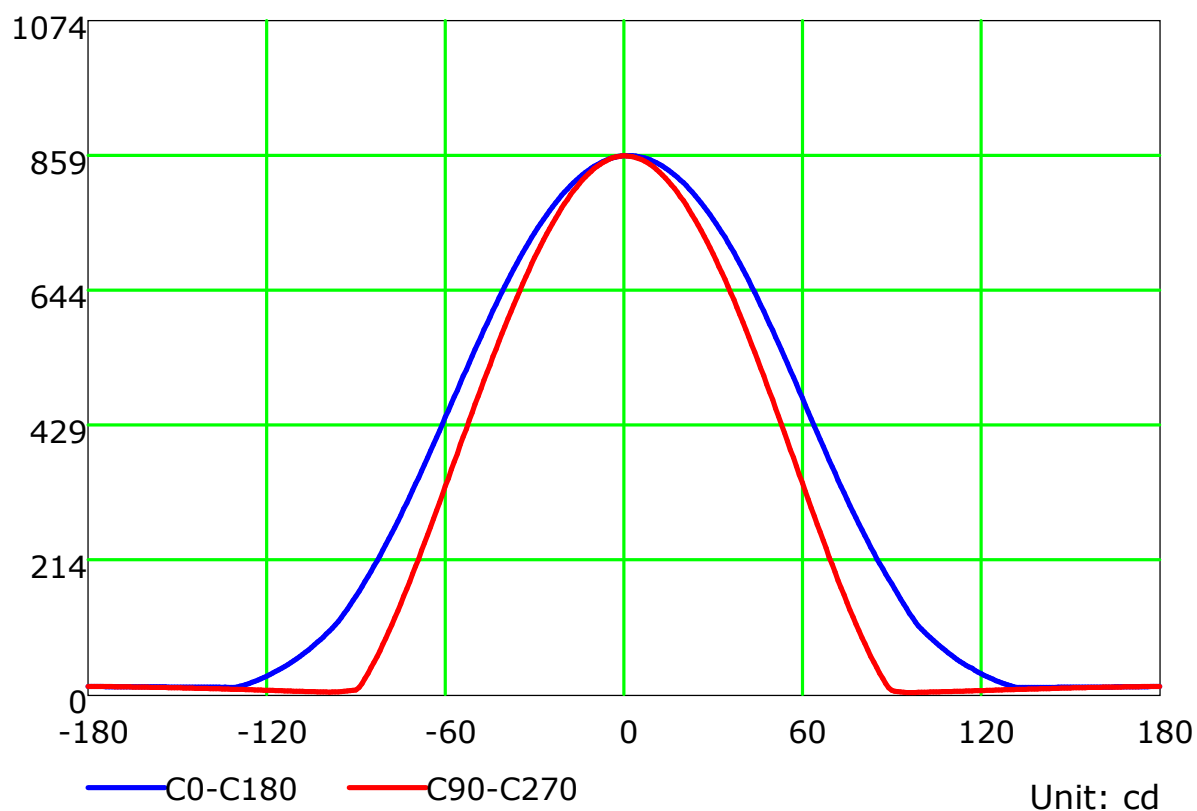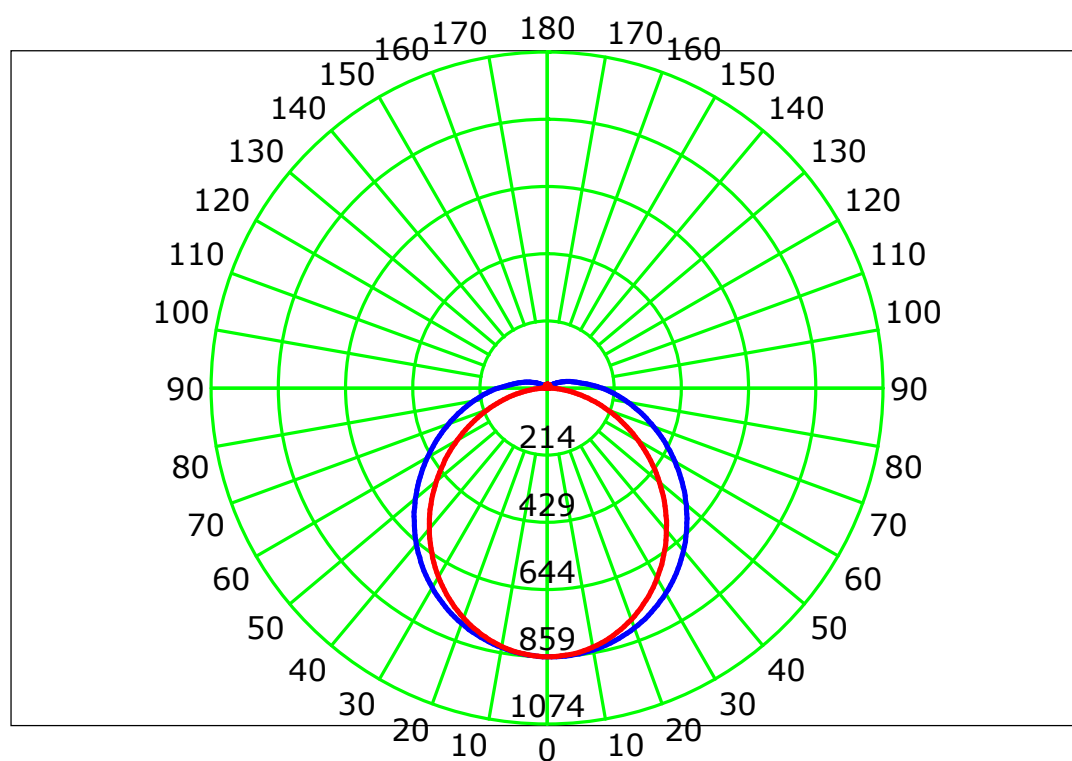

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

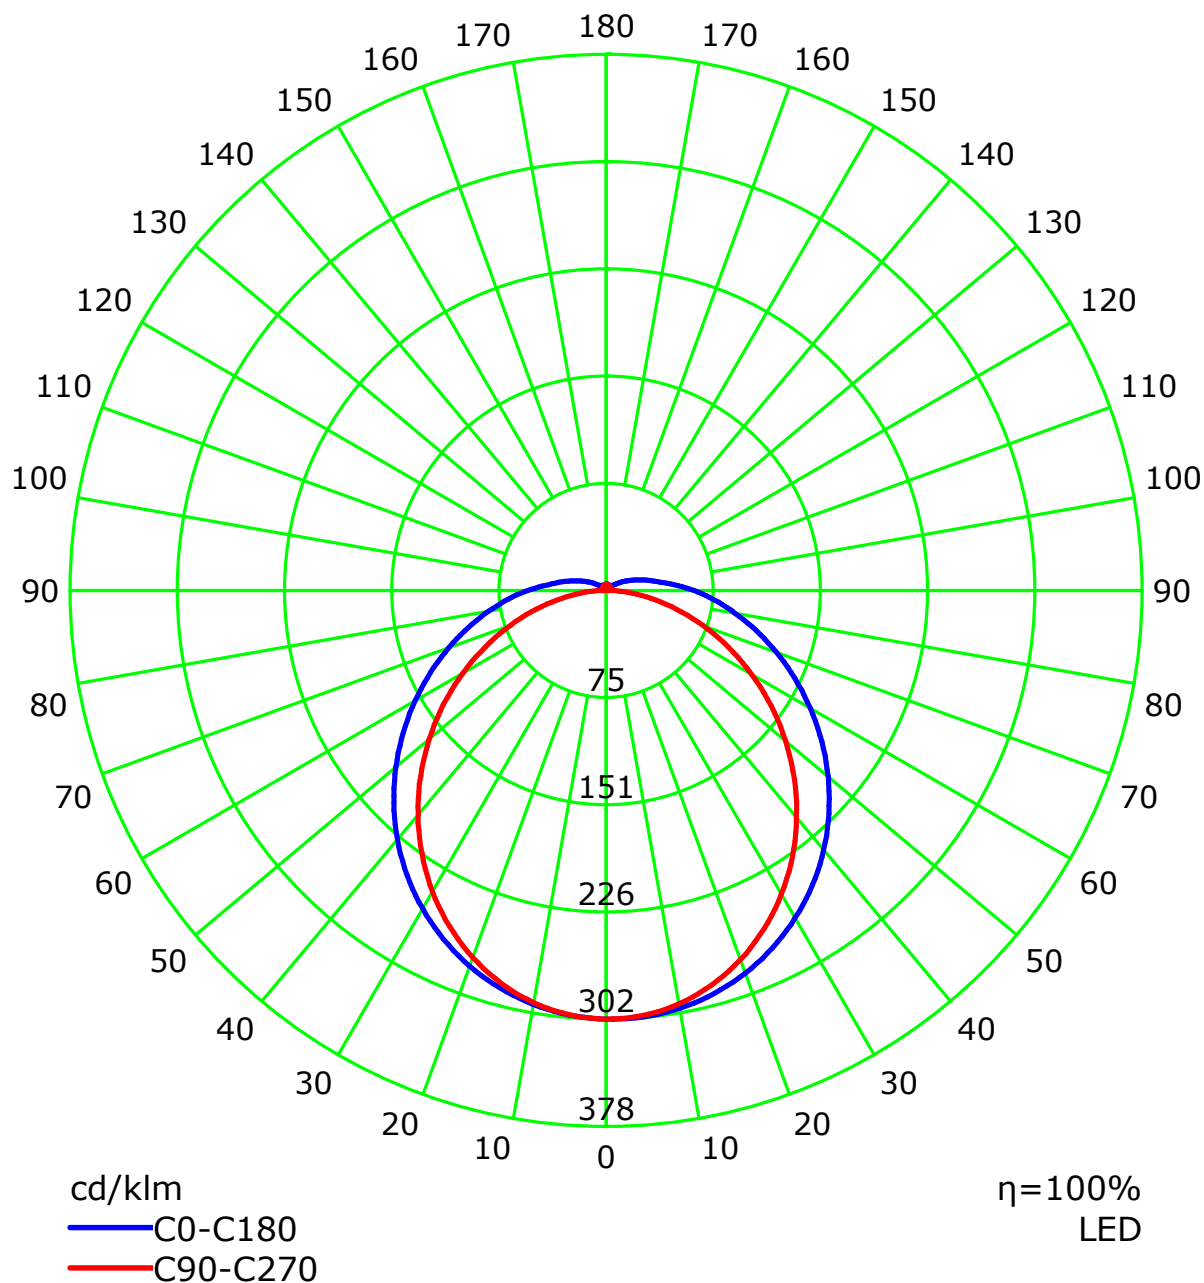

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:


Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	118	118	118	118	114	114	114	114	108	108	108	102	102	102	96	96	96	94
1	106	100	95	91	102	97	93	89	92	88	85	87	84	81	82	80	78	75
2	95	87	79	73	92	84	77	71	79	74	69	75	70	66	71	67	64	61
3	87	76	67	60	84	73	65	59	70	63	57	66	60	55	63	58	54	51
4	79	67	58	51	76	65	56	50	62	54	48	59	52	47	56	50	46	43
5	73	59	50	43	70	58	49	43	55	48	42	52	46	41	50	44	40	37
6	67	53	44	38	65	52	44	37	50	42	36	47	41	36	45	39	35	33
7	62	48	39	33	60	47	39	33	45	38	32	43	36	31	41	35	31	29
8	58	44	35	29	56	43	35	29	41	34	29	40	33	28	38	32	28	26
9	54	40	32	26	52	40	32	26	38	31	26	36	30	25	35	29	25	23
10	51	37	29	24	49	37	29	24	35	28	23	34	27	23	33	27	23	21

Spacing Criteria (0-180): 1.29

Spacing Criteria (90-270): 1.21

Spacing Criteria (Diagonal): 1.38

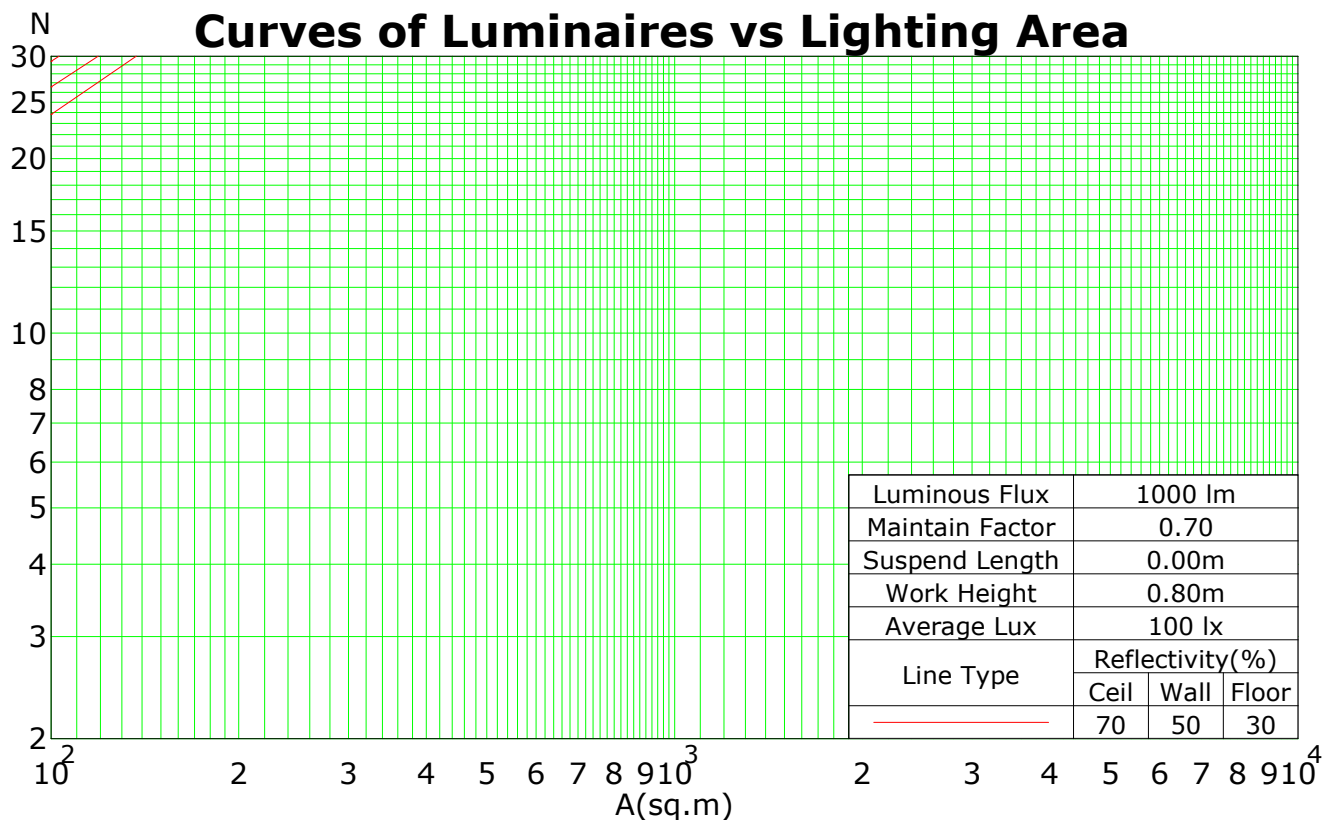

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector:

IsoLux Plot

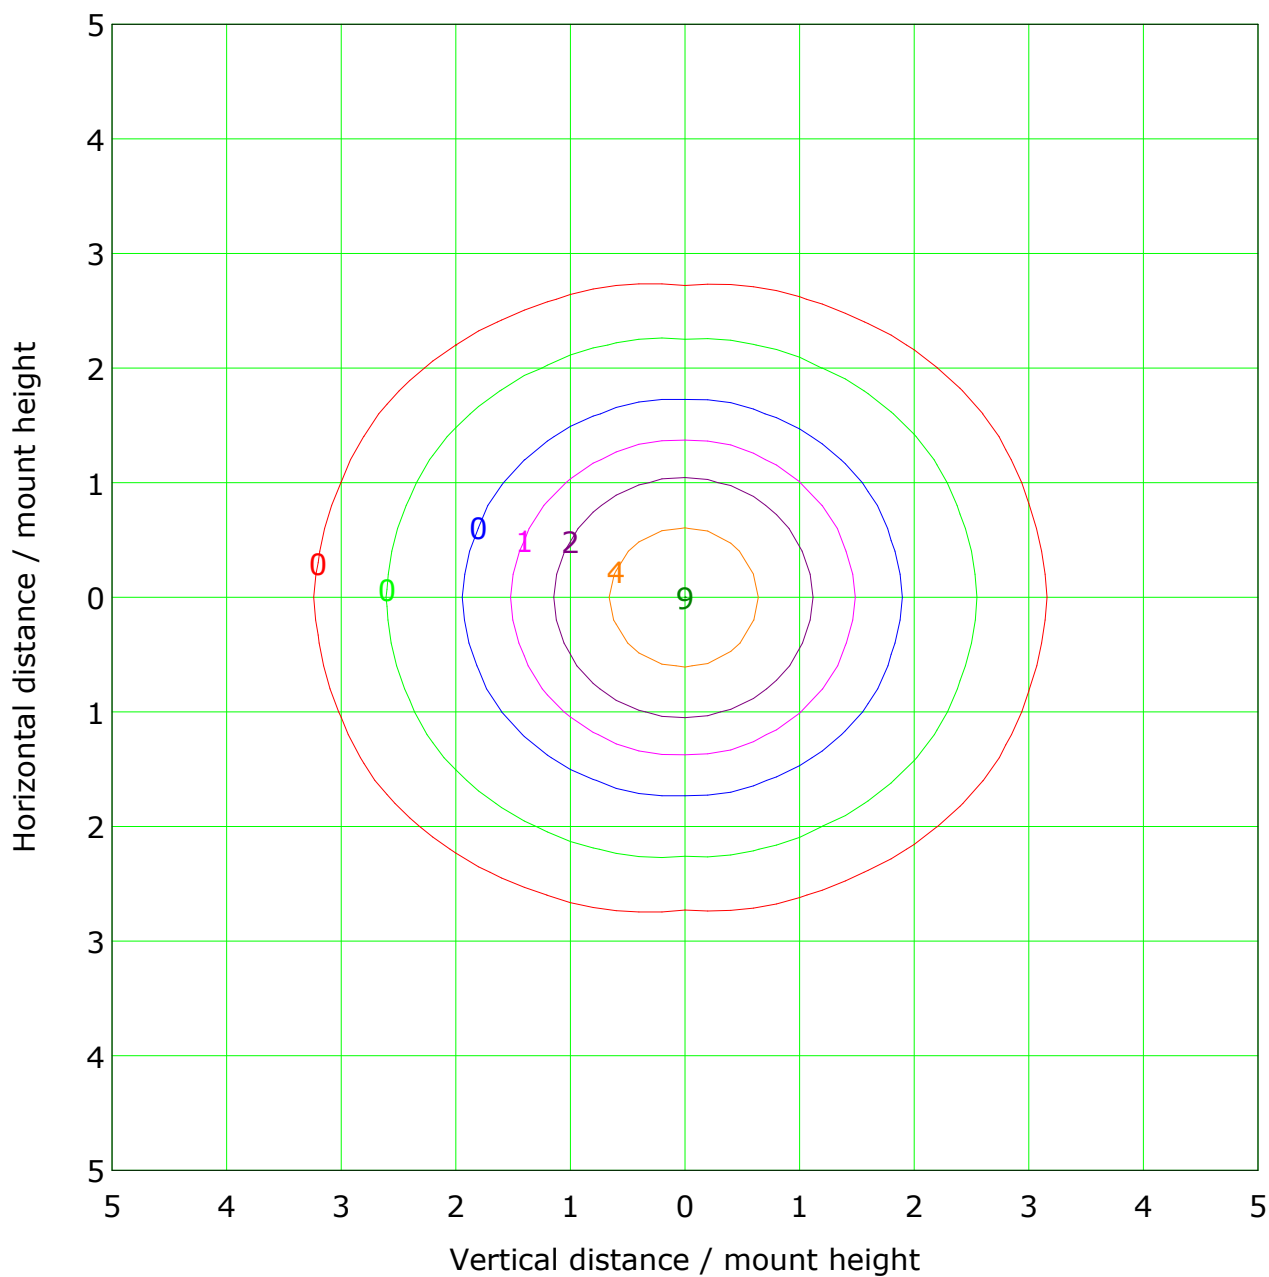

Mounting Height: 10.0m Max Lux(100%): 8.6 lx

(1%): 0.1 lx	(2%): 0.2 lx
(5%): 0.4 lx	(10%): 0.9 lx
(20%): 1.7 lx	(50%): 4.3 lx
(100%): 8.6 lx	

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 9.010 m



Humidity:

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

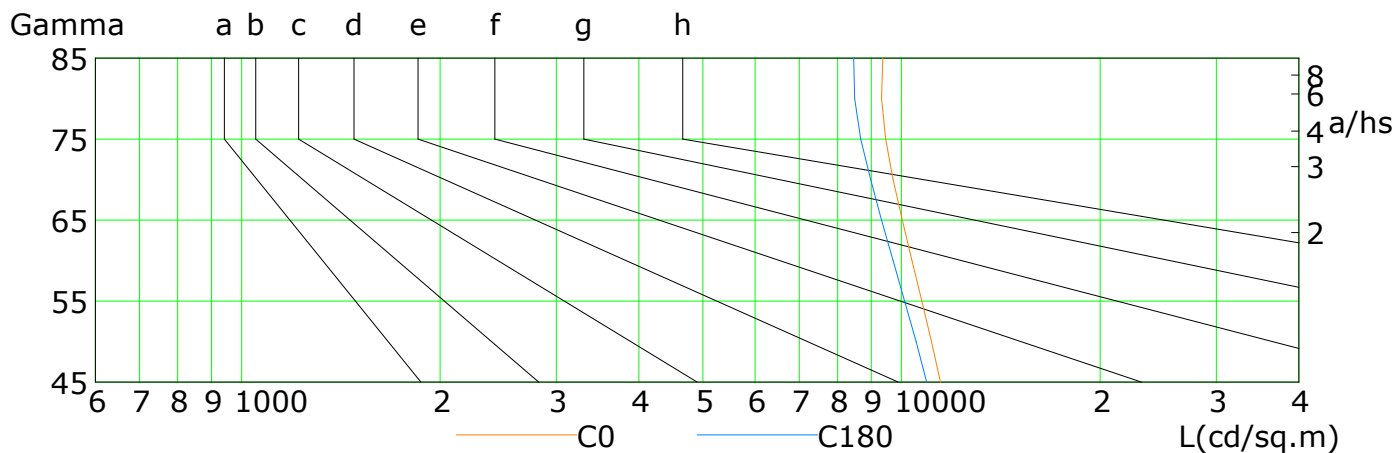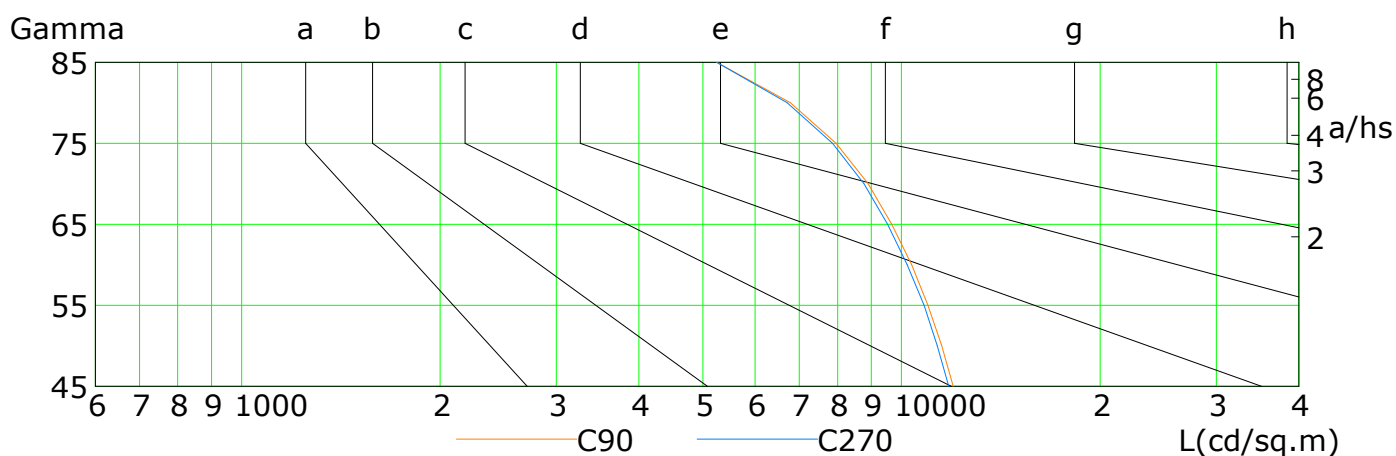


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	11456	11100	10740	10373	10029	9706	9462	9322	9365
C90	11979	11504	10962	10356	9665	8898	7959	6784	5245
C180	10914	10518	10111	9708	9327	8977	8676	8496	8466
C270	11799	11334	10816	10197	9525	8768	7860	6713	5245

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:


Illuminance at a Distance

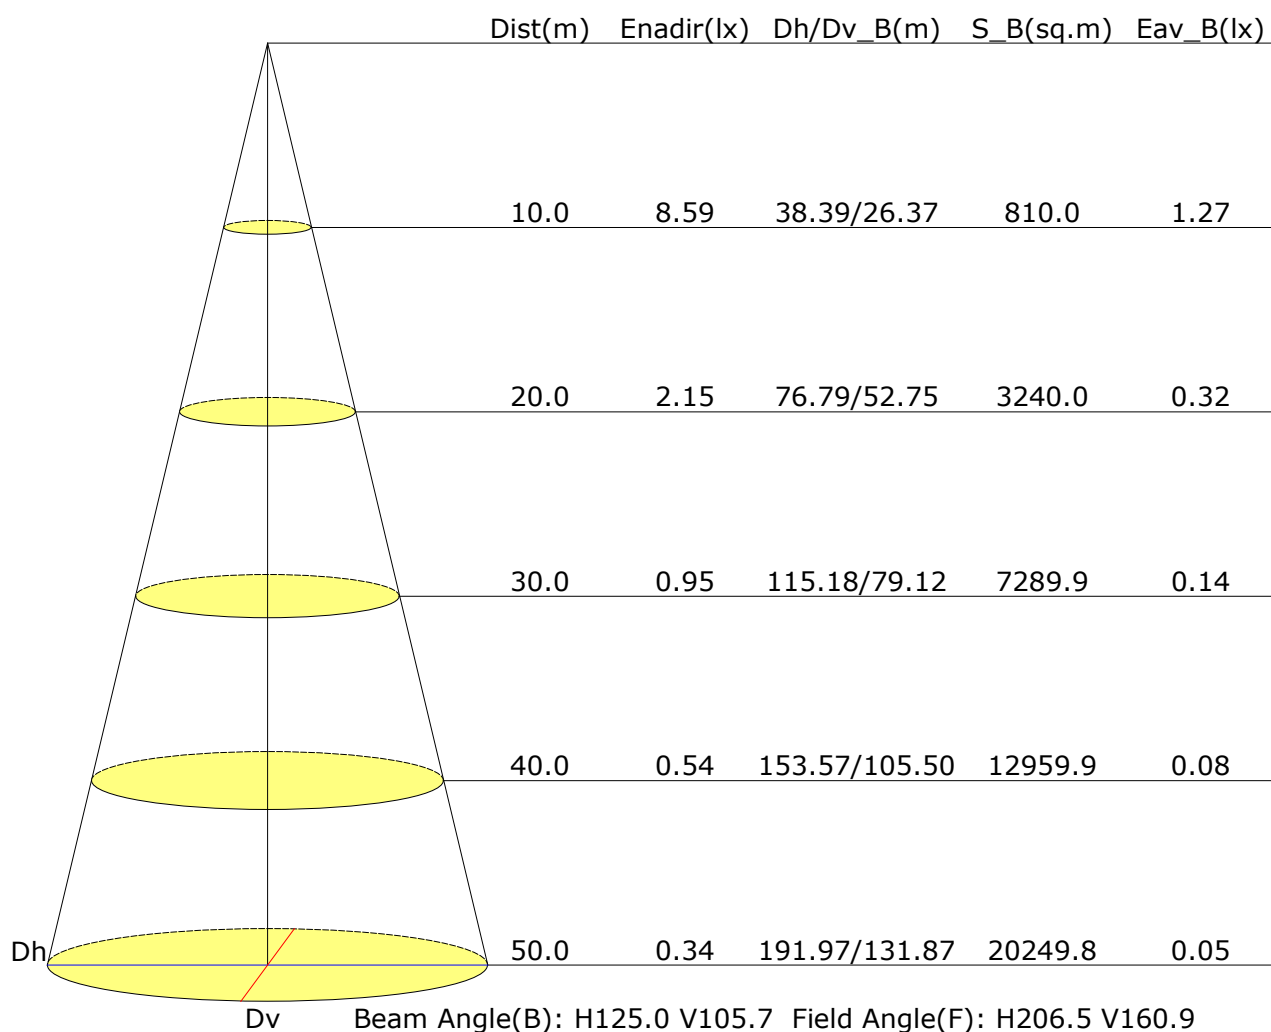

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

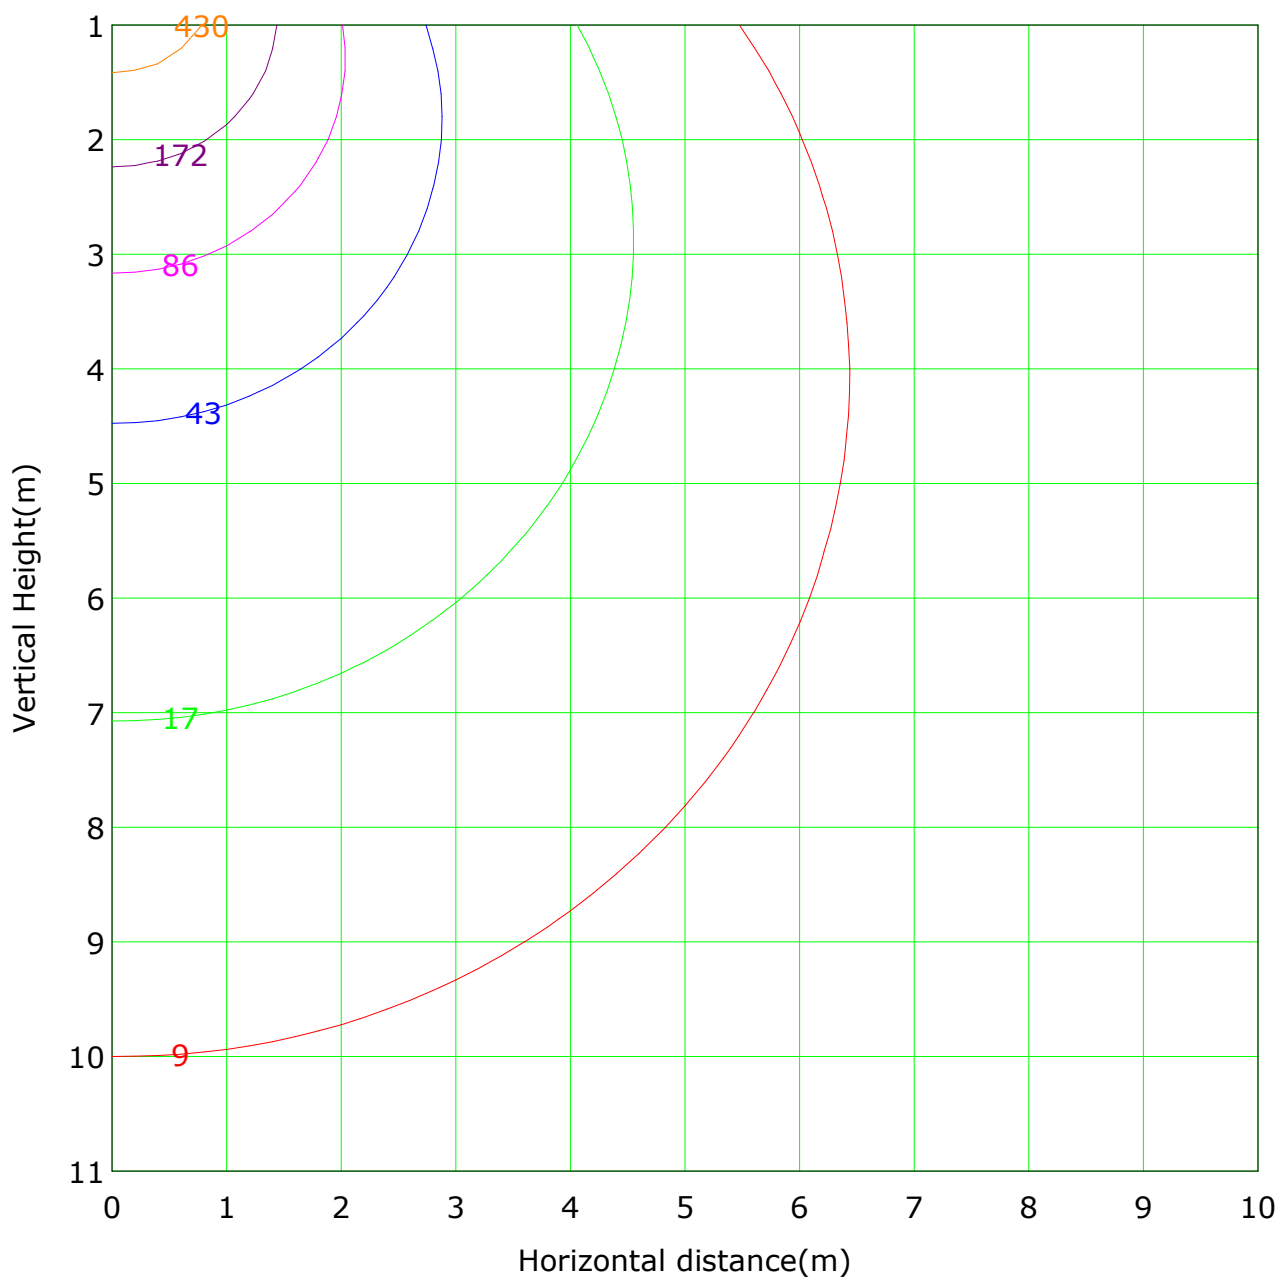

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 859.1 lx

— (1%): 8.6 lx	— (2%): 17.2 lx
— (5%): 43.0 lx	— (10%): 85.9 lx
— (20%): 171.8 lx	— (50%): 429.6 lx
— (100%): 859.1 lx	

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:

Area Flux Table


Unit: lm

Vertical plane		-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90
Flux(E)	Flux(T)	0.4	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.6	0.6	0.5	0.5	0.5	0.5	0.5	0.5	0.4	0.4	8.9
8.9	32.7	1.2	1.4	1.5	1.7	1.9	2.0	2.1	2.2	2.3	2.3	2.2	2.1	2.1	2.0	1.9	1.7	1.5	1.4	32.7
32.7	65.7	2.0	2.4	2.8	3.3	3.8	4.2	4.6	4.8	5.0	5.0	4.8	4.6	4.6	4.2	3.8	3.3	2.8	2.4	65.7
65.7	106.2	2.5	3.3	4.2	5.2	6.2	7.0	7.7	8.3	8.6	8.6	8.3	7.7	7.1	7.1	6.2	5.2	4.2	3.3	106.2
106.2	149.7	2.7	4.0	5.5	7.1	8.7	10.2	11.4	12.3	12.9	12.8	12.3	11.4	10.2	10.3	8.8	7.1	5.5	4.0	149.7
149.7	191.4	2.6	4.4	6.5	8.9	11.2	13.4	15.2	16.5	17.2	17.2	16.5	15.2	13.4	13.5	11.3	8.9	6.5	4.3	191.4
191.4	226.8	2.4	4.6	7.4	10.4	13.4	16.2	18.5	20.2	21.1	21.1	20.2	18.5	16.2	16.3	13.5	10.4	7.4	4.6	226.8
226.8	254.0	2.1	4.8	8.0	11.6	15.1	18.3	21.0	23.0	24.0	24.0	23.0	21.0	18.3	18.5	15.2	11.7	8.1	4.8	254.0
254.0	267.6	1.6	4.6	8.2	12.1	15.9	19.5	22.4	24.5	25.6	25.6	24.5	22.4	19.5	19.6	16.1	12.3	8.3	4.7	267.6
267.6	269.1	1.6	4.7	8.3	12.2	16.0	19.5	22.5	24.6	25.8	25.8	24.6	22.5	19.5	19.8	16.3	12.4	8.4	4.7	269.1
269.1	258.5	2.1	4.9	8.2	11.8	15.3	18.5	21.3	23.3	24.3	24.3	23.3	21.3	18.5	18.8	15.6	12.0	8.4	5.0	258.5
258.5	233.6	2.5	4.8	7.6	10.6	13.7	16.5	18.9	20.6	21.5	21.5	20.6	18.9	16.5	16.8	14.0	10.9	7.8	5.0	233.6
233.6	199.5	2.7	4.5	6.8	9.2	11.6	13.8	15.7	17.0	17.8	17.8	17.0	15.7	13.8	14.1	11.9	9.4	7.0	4.7	199.5
199.5	157.7	2.8	4.1	5.7	7.4	9.1	10.7	11.9	12.9	13.4	13.4	12.9	11.9	10.7	10.9	9.3	7.6	5.9	4.3	157.7
157.7	113.2	2.6	3.5	4.5	5.5	6.5	7.4	8.2	8.8	9.1	9.1	8.8	8.2	7.4	7.5	6.7	5.7	4.6	3.6	113.2
113.2	70.9	2.1	2.6	3.0	3.6	4.0	4.5	4.9	5.2	5.4	5.4	5.2	4.9	4.5	4.6	4.1	3.6	3.1	2.6	70.9
70.9	35.7	1.3	1.5	1.7	1.9	2.0	2.2	2.3	2.4	2.5	2.5	2.4	2.3	2.2	2.2	2.0	1.9	1.7	1.5	35.7
35.7	9.9	0.5	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.5	0.5	0.5	9.9
9.9	2651	35.7	60.9	91.0	123.4	155.6	185.1	209.8	227.6	237.6	238.0	228.8	211.5	187.2	157.7	125.3	92.4	61.8	36.4	2666
2666		28.4	60.9	91.0	123.4	155.6	185.1	209.8	227.6	237.6	238.0	228.8	211.5	187.2	157.7	125.3	92.4	61.8	36.4	2666

C Plane (°):0.0-360.0: 30.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 25
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 9.010 m
 Humidity:
 Inspector:

The Average Illuminance Effective Figure

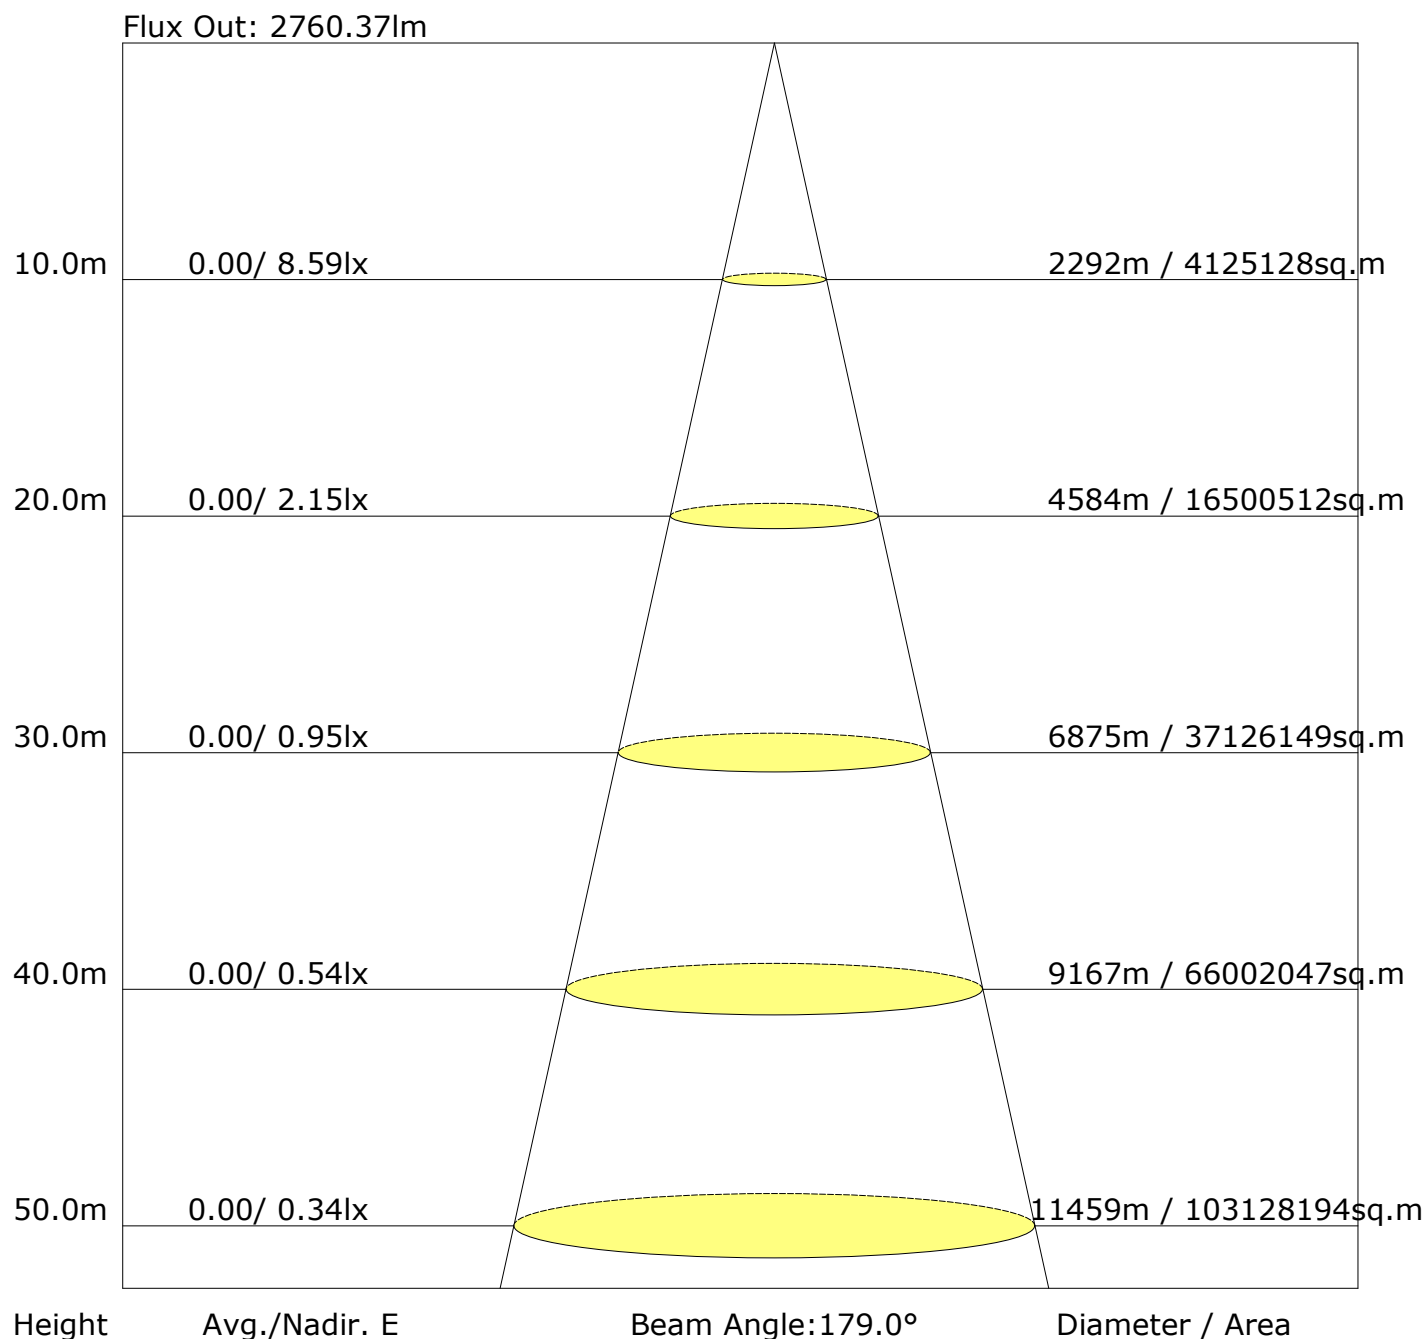

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	20.6	22.0	21.0	22.3	22.7	19.9	21.3	20.3	21.6	22.0
3H	22.5	23.7	22.9	24.1	24.5	21.3	22.6	21.8	23.0	23.4
4H	23.4	24.6	23.8	25.0	25.4	21.9	23.1	22.4	23.5	23.9
6H	24.2	25.3	24.7	25.8	26.2	22.3	23.4	22.8	23.9	24.3
8H	24.6	25.7	25.1	26.1	26.6	22.5	23.6	23.0	24.0	24.5
12H	25.0	26.1	25.5	26.5	27.0	22.6	23.6	23.1	24.0	24.5
X=4H Y=2H	21.2	22.4	21.6	22.8	23.2	20.6	21.8	21.1	22.2	22.6
3H	23.3	24.3	23.8	24.7	25.2	22.3	23.3	22.7	23.7	24.2
4H	24.3	25.3	24.8	25.7	26.2	23.0	23.9	23.5	24.4	24.9
6H	25.4	26.2	25.9	26.7	27.2	23.5	24.4	24.1	24.9	25.4
8H	25.9	26.6	26.4	27.1	27.7	23.8	24.5	24.3	25.0	25.6
12H	26.4	27.0	26.9	27.6	28.1	23.9	24.6	24.5	25.1	25.7
X=8H Y=4H	24.6	25.4	25.2	25.9	26.5	23.4	24.2	24.0	24.7	25.3
6H	25.9	26.5	26.4	27.0	27.6	24.2	24.8	24.8	25.4	26.0
8H	26.5	27.1	27.1	27.6	28.2	24.5	25.1	25.1	25.6	26.3
12H	27.2	27.7	27.8	28.2	28.9	24.8	25.3	25.4	25.8	26.5
X=12H Y=4H	24.6	25.3	25.2	25.9	26.4	23.5	24.2	24.1	24.7	25.3
6H	26.0	26.5	26.5	27.1	27.7	24.4	24.9	25.0	25.5	26.1
8H	26.7	27.1	27.2	27.7	28.4	24.8	25.3	25.4	25.8	26.5
Variations with the observer position at spacings:										
S=1.0H	+0.2/-0.2					+0.2/-0.2				
S=1.5H	+0.4/-0.4					+0.4/-0.5				
S=2.0H	+0.5/-0.7					+0.5/-0.9				

Calculate in accordance with CIE Pub.117. The table is revised with 2842lm ($8\log(F/F_0) = 3.6$).

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

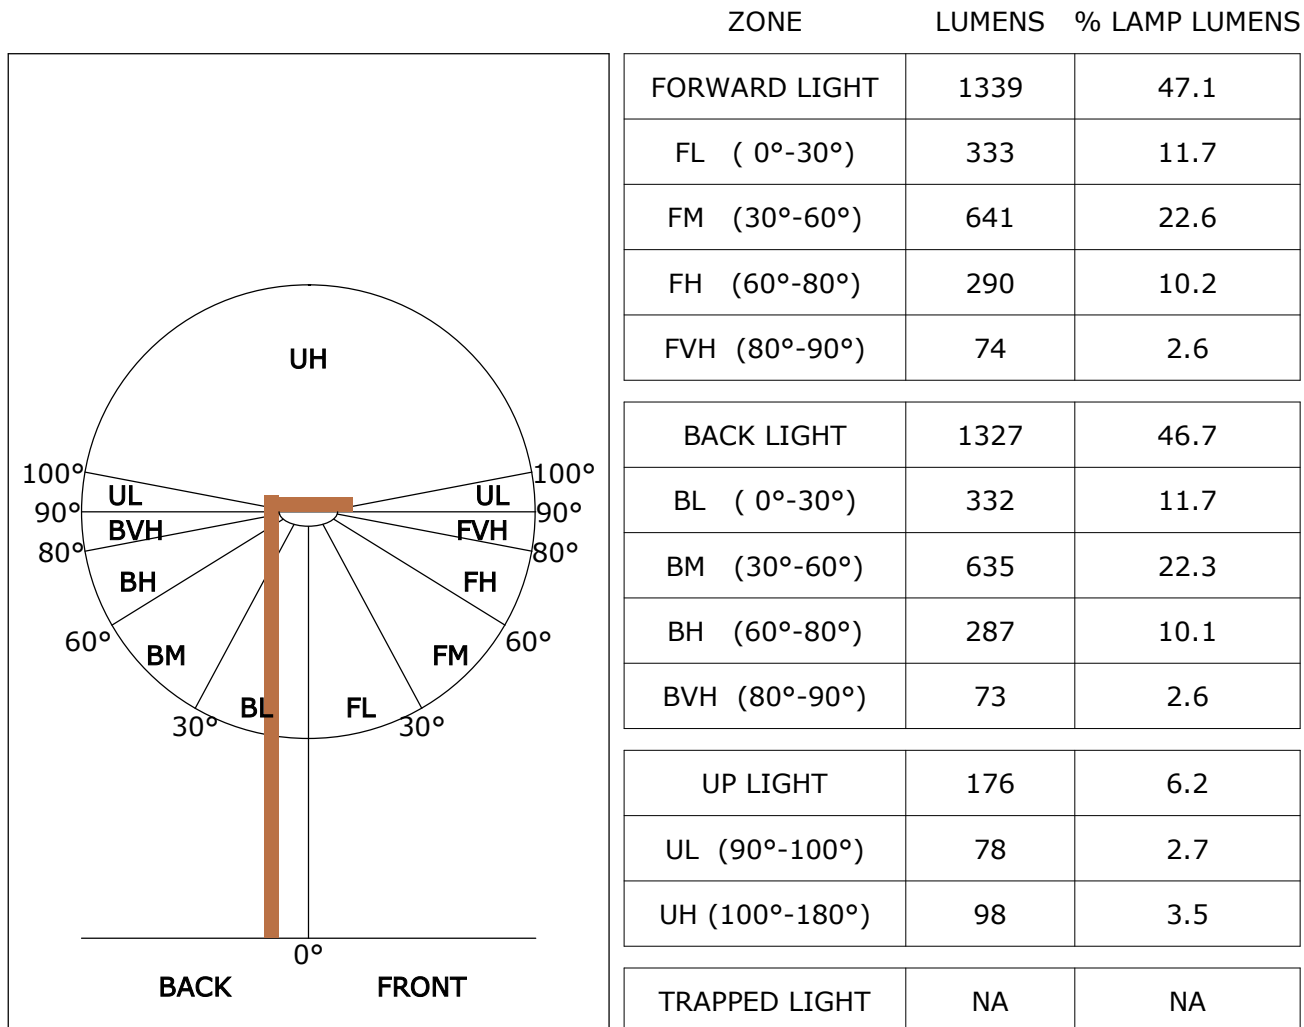

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U2 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U2 G1

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	859.1	0.8	0.8	0.03	0.03
1.0-2.0	858.8	2.5	3.3	0.09	0.12
2.0-3.0	858.2	4.1	7.4	0.14	0.26
3.0-4.0	857.2	5.7	13.1	0.20	0.46
4.0-5.0	856.0	7.4	20.5	0.26	0.72
5.0-6.0	854.4	9.0	29.5	0.32	1.04
6.0-7.0	852.5	10.6	40.1	0.37	1.41
7.0-8.0	850.3	12.2	52.2	0.43	1.84
8.0-9.0	847.7	13.7	66.0	0.48	2.32
9.0-10.0	844.9	15.3	81.3	0.54	2.86
10.0-11.0	841.7	16.8	98.1	0.59	3.45
11.0-12.0	838.2	18.3	116.4	0.64	4.10
12.0-13.0	834.6	19.8	136.2	0.70	4.79
13.0-14.0	830.5	21.3	157.5	0.75	5.54
14.0-15.0	826.2	22.7	180.2	0.80	6.34
15.0-16.0	821.4	24.1	204.2	0.85	7.19
16.0-17.0	816.4	25.4	229.7	0.89	8.08
17.0-18.0	811.4	26.8	256.4	0.94	9.02
18.0-19.0	805.8	28.0	284.5	0.99	10.01
19.0-20.0	799.9	29.3	313.7	1.03	11.04
20.0-21.0	794.1	30.5	344.2	1.07	12.11
21.0-22.0	787.7	31.7	375.9	1.11	13.23
22.0-23.0	781.1	32.8	408.7	1.15	14.38
23.0-24.0	774.1	33.8	442.5	1.19	15.57
24.0-25.0	766.9	34.9	477.4	1.23	16.80
25.0-26.0	759.8	35.9	513.3	1.26	18.06
26.0-27.0	752.0	36.8	550.1	1.29	19.35
27.0-28.0	744.2	37.7	587.7	1.33	20.68
28.0-29.0	736.3	38.5	626.3	1.36	22.04
29.0-30.0	727.9	39.3	665.6	1.38	23.42
30.0-31.0	719.3	40.0	705.6	1.41	24.83
31.0-32.0	710.5	40.7	746.3	1.43	26.26
32.0-33.0	701.4	41.3	787.7	1.45	27.71
33.0-34.0	692.4	41.9	829.6	1.47	29.19
34.0-35.0	682.9	42.4	872.0	1.49	30.68
35.0-36.0	673.3	42.9	914.9	1.51	32.19

C Plane (°):0.0-360.0: 30.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 25
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 9.010 m
 Humidity:
 Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	663.6	43.3	958.1	1.52	33.71
37.0-38.0	653.5	43.6	1001.8	1.54	35.25
38.0-39.0	643.5	43.9	1045.7	1.55	36.79
39.0-40.0	633.0	44.2	1089.9	1.55	38.35
40.0-41.0	622.4	44.3	1134.2	1.56	39.91
41.0-42.0	612.1	44.5	1178.7	1.56	41.47
42.0-43.0	601.3	44.5	1223.2	1.57	43.04
43.0-44.0	590.2	44.6	1267.8	1.57	44.61
44.0-45.0	579.2	44.5	1312.3	1.57	46.17
45.0-46.0	567.9	44.4	1356.7	1.56	47.74
46.0-47.0	556.7	44.3	1401.0	1.56	49.30
47.0-48.0	545.0	44.1	1445.0	1.55	50.85
48.0-49.0	533.4	43.8	1488.8	1.54	52.39
49.0-50.0	522.2	43.5	1532.4	1.53	53.92
50.0-51.0	510.4	43.2	1575.6	1.52	55.44
51.0-52.0	498.7	42.8	1618.4	1.51	56.94
52.0-53.0	487.0	42.4	1660.8	1.49	58.44
53.0-54.0	475.0	41.9	1702.6	1.47	59.91
54.0-55.0	463.3	41.4	1744.0	1.46	61.36
55.0-56.0	451.3	40.8	1784.8	1.44	62.80
56.0-57.0	439.3	40.2	1824.9	1.41	64.21
57.0-58.0	427.7	39.6	1864.5	1.39	65.60
58.0-59.0	415.5	38.8	1903.3	1.37	66.97
59.0-60.0	403.4	38.1	1941.5	1.34	68.31
60.0-61.0	391.4	37.4	1978.8	1.31	69.63
61.0-62.0	379.4	36.6	2015.4	1.29	70.91
62.0-63.0	367.8	35.8	2051.2	1.26	72.17
63.0-64.0	355.9	34.9	2086.1	1.23	73.40
64.0-65.0	344.1	34.1	2120.1	1.20	74.60
65.0-66.0	332.8	33.2	2153.4	1.17	75.77
66.0-67.0	321.1	32.3	2185.6	1.14	76.90
67.0-68.0	309.6	31.4	2217.0	1.10	78.01
68.0-69.0	298.1	30.4	2247.4	1.07	79.08
69.0-70.0	286.8	29.5	2276.9	1.04	80.12
70.0-71.0	276.1	28.5	2305.4	1.00	81.12
71.0-72.0	264.9	27.6	2333.0	0.97	82.09

C Plane (°):0.0-360.0: 30.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 25
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 9.010 m
 Humidity:
 Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	254.0	26.6	2359.5	0.93	83.02
73.0-74.0	243.7	25.6	2385.2	0.90	83.93
74.0-75.0	233.0	24.6	2409.8	0.87	84.79
75.0-76.0	222.5	23.6	2433.4	0.83	85.62
76.0-77.0	212.3	22.6	2456.0	0.80	86.42
77.0-78.0	202.2	21.6	2477.7	0.76	87.18
78.0-79.0	192.7	20.7	2498.4	0.73	87.91
79.0-80.0	183.1	19.7	2518.1	0.69	88.60
80.0-81.0	173.6	18.8	2536.9	0.66	89.27
81.0-82.0	164.6	17.8	2554.8	0.63	89.89
82.0-83.0	155.6	16.9	2571.7	0.60	90.49
83.0-84.0	147.1	16.0	2587.7	0.56	91.05
84.0-85.0	138.6	15.1	2602.8	0.53	91.58
85.0-86.0	130.3	14.2	2617.1	0.50	92.09
86.0-87.0	122.6	13.4	2630.5	0.47	92.56
87.0-88.0	114.9	12.6	2643.1	0.44	93.00
88.0-89.0	107.5	11.8	2654.9	0.41	93.42
89.0-90.0	100.6	11.0	2665.9	0.39	93.80
90.0-91.0	94.3	10.3	2676.3	0.36	94.17
91.0-92.0	88.5	9.7	2685.9	0.34	94.51
92.0-93.0	82.6	9.1	2695.0	0.32	94.83
93.0-94.0	77.1	8.4	2703.4	0.30	95.12
94.0-95.0	72.1	7.9	2711.3	0.28	95.40
95.0-96.0	67.3	7.4	2718.7	0.26	95.66
96.0-97.0	63.2	6.9	2725.5	0.24	95.90
97.0-98.0	59.6	6.5	2732.0	0.23	96.13
98.0-99.0	56.2	6.1	2738.1	0.21	96.34
99.0-100.0	53.0	5.7	2743.8	0.20	96.55
100.0-101.0	50.1	5.4	2749.2	0.19	96.74
101.0-102.0	47.2	5.1	2754.3	0.18	96.91
102.0-103.0	44.6	4.8	2759.1	0.17	97.08
103.0-104.0	42.1	4.5	2763.6	0.16	97.24
104.0-105.0	39.8	4.2	2767.8	0.15	97.39
105.0-106.0	37.6	4.0	2771.8	0.14	97.53
106.0-107.0	35.4	3.7	2775.5	0.13	97.66
107.0-108.0	33.4	3.5	2779.0	0.12	97.78

C Plane (°):0.0-360.0: 30.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 25
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 9.010 m
 Humidity:
 Inspector:

Zonal Lumen (Continue 3)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-109.0	31.4	3.3	2782.3	0.12	97.90
109.0-110.0	29.6	3.1	2785.3	0.11	98.01
110.0-111.0	27.9	2.9	2788.2	0.10	98.11
111.0-112.0	26.3	2.7	2790.9	0.09	98.20
112.0-113.0	24.7	2.5	2793.4	0.09	98.29
113.0-114.0	23.1	2.3	2795.7	0.08	98.37
114.0-115.0	21.6	2.2	2797.9	0.08	98.45
115.0-116.0	20.3	2.0	2799.9	0.07	98.52
116.0-117.0	19.0	1.9	2801.7	0.07	98.58
117.0-118.0	17.8	1.7	2803.5	0.06	98.64
118.0-119.0	16.8	1.6	2805.1	0.06	98.70
119.0-120.0	15.8	1.5	2806.6	0.05	98.75
120.0-121.0	14.9	1.4	2808.0	0.05	98.80
121.0-122.0	14.1	1.3	2809.3	0.05	98.85
122.0-123.0	13.3	1.2	2810.6	0.04	98.89
123.0-124.0	12.6	1.2	2811.7	0.04	98.93
124.0-125.0	11.9	1.1	2812.8	0.04	98.97
125.0-126.0	11.4	1.0	2813.8	0.04	99.01
126.0-127.0	10.9	1.0	2814.8	0.03	99.04
127.0-128.0	10.4	0.9	2815.7	0.03	99.07
128.0-129.0	10.2	0.9	2816.5	0.03	99.10
129.0-130.0	10.0	0.8	2817.4	0.03	99.13
130.0-131.0	9.9	0.8	2818.2	0.03	99.16
131.0-132.0	9.8	0.8	2819.0	0.03	99.19
132.0-133.0	9.8	0.8	2819.8	0.03	99.22
133.0-134.0	9.9	0.8	2820.6	0.03	99.25
134.0-135.0	10.0	0.8	2821.4	0.03	99.27
135.0-136.0	10.0	0.8	2822.1	0.03	99.30
136.0-137.0	10.1	0.8	2822.9	0.03	99.33
137.0-138.0	10.2	0.8	2823.7	0.03	99.35
138.0-139.0	10.3	0.7	2824.4	0.03	99.38
139.0-140.0	10.4	0.7	2825.1	0.03	99.41
140.0-141.0	10.5	0.7	2825.9	0.03	99.43
141.0-142.0	10.6	0.7	2826.6	0.03	99.46
142.0-143.0	10.7	0.7	2827.3	0.03	99.48
143.0-144.0	10.8	0.7	2828.0	0.02	99.51

C Plane (°):0.0-360.0: 30.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 25
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 9.010 m
 Humidity:
 Inspector:

Zonal Lumen (Continue 4)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-145.0	10.8	0.7	2828.7	0.02	99.53
145.0-146.0	10.9	0.7	2829.4	0.02	99.56
146.0-147.0	11.0	0.7	2830.0	0.02	99.58
147.0-148.0	11.1	0.7	2830.7	0.02	99.60
148.0-149.0	11.2	0.6	2831.3	0.02	99.62
149.0-150.0	11.3	0.6	2832.0	0.02	99.65
150.0-151.0	11.3	0.6	2832.6	0.02	99.67
151.0-152.0	11.4	0.6	2833.2	0.02	99.69
152.0-153.0	11.5	0.6	2833.8	0.02	99.71
153.0-154.0	11.6	0.6	2834.3	0.02	99.73
154.0-155.0	11.6	0.5	2834.9	0.02	99.75
155.0-156.0	11.7	0.5	2835.4	0.02	99.77
156.0-157.0	11.8	0.5	2835.9	0.02	99.79
157.0-158.0	11.8	0.5	2836.4	0.02	99.80
158.0-159.0	11.9	0.5	2836.9	0.02	99.82
159.0-160.0	11.9	0.5	2837.3	0.02	99.84
160.0-161.0	12.0	0.4	2837.8	0.02	99.85
161.0-162.0	12.0	0.4	2838.2	0.01	99.87
162.0-163.0	12.1	0.4	2838.6	0.01	99.88
163.0-164.0	12.1	0.4	2839.0	0.01	99.89
164.0-165.0	12.2	0.4	2839.3	0.01	99.91
165.0-166.0	12.3	0.3	2839.7	0.01	99.92
166.0-167.0	12.3	0.3	2840.0	0.01	99.93
167.0-168.0	12.4	0.3	2840.3	0.01	99.94
168.0-169.0	12.4	0.3	2840.6	0.01	99.95
169.0-170.0	12.5	0.2	2840.8	0.01	99.96
170.0-171.0	12.5	0.2	2841.0	0.01	99.97
171.0-172.0	12.6	0.2	2841.2	0.01	99.97
172.0-173.0	12.6	0.2	2841.4	0.01	99.98
173.0-174.0	12.6	0.2	2841.6	0.01	99.98
174.0-175.0	12.7	0.1	2841.7	0.00	99.99
175.0-176.0	12.8	0.1	2841.8	0.00	99.99
176.0-177.0	12.8	0.1	2841.9	0.00	100.00
177.0-178.0	12.9	0.1	2842.0	0.00	100.00
178.0-179.0	13.0	0.0	2842.0	0.00	100.00
179.0-180.0	13.1	0.0	2842.0	0.00	100.00

C Plane (°):0.0-360.0: 30.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 25
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 9.010 m
 Humidity:
 Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C30.0	C60.0	C90.0	C120.0	C150.0	C180.0	C210.0	C240.0	C270.0
G0.0	859.1	859.1	859.1	859.1	859.1	859.1	859.1	859.1	859.1	859.1
G1.0	859.4	859.5	859.2	858.8	859.2	858.9	858.6	858.8	858.5	858.6
G2.0	859.1	859.5	859.0	858.3	858.6	858.4	858.0	858.1	857.6	857.8
G3.0	859.2	859.3	858.6	857.6	857.6	857.4	856.6	856.9	856.6	857.0
G4.0	858.6	858.8	857.7	856.2	856.4	856.0	855.8	855.3	854.8	855.4
G5.0	857.9	857.8	856.3	854.8	854.9	854.7	854.0	853.8	853.3	853.4
G6.0	856.9	856.5	854.9	853.0	852.7	852.9	852.2	851.7	850.7	851.0
G7.0	855.7	855.1	853.1	850.6	850.5	850.6	850.0	849.6	848.3	848.7
G8.0	854.3	853.4	850.8	848.0	848.0	848.4	847.3	847.0	845.3	845.7
G9.0	852.4	851.7	847.9	844.8	844.7	845.1	844.9	844.2	842.3	842.4
G10.0	850.3	849.2	844.8	841.3	841.5	842.4	842.3	841.2	838.9	838.9
G11.0	848.1	846.7	841.7	837.4	837.7	839.0	839.2	837.4	834.5	834.4
G12.0	845.4	844.1	838.3	833.2	833.5	835.7	836.0	834.0	830.4	830.2
G13.0	842.7	841.1	834.3	828.6	829.3	832.2	832.6	830.1	826.3	825.5
G14.0	839.6	837.6	830.1	823.6	824.5	827.7	828.8	826.0	821.0	820.3
G15.0	836.4	834.3	825.8	818.4	819.5	823.9	824.7	822.0	815.9	815.0
G16.0	832.5	829.8	820.1	812.7	814.0	819.0	820.2	816.5	809.7	808.7
G17.0	828.8	825.6	815.1	807.2	808.7	814.0	815.9	811.9	804.4	802.9
G18.0	825.1	821.2	810.0	801.1	802.7	809.2	811.5	806.8	798.9	796.9
G19.0	820.7	815.8	803.4	794.0	796.3	803.7	806.1	800.9	791.6	789.5
G20.0	816.2	811.4	797.9	787.6	789.5	798.0	800.9	795.6	785.3	782.9
G21.0	811.6	806.3	791.6	780.6	782.9	792.2	795.9	789.8	778.4	775.3
G22.0	806.3	800.5	784.4	772.5	775.6	785.8	789.8	783.4	770.9	767.4
G23.0	801.5	794.6	777.8	765.0	768.2	779.9	784.1	777.3	763.9	759.9
G24.0	795.5	788.4	769.9	756.9	760.2	772.7	777.4	769.7	755.4	751.0
G25.0	790.1	782.3	762.6	748.5	752.4	766.4	771.6	763.2	747.8	743.1
G26.0	784.1	776.2	754.6	740.1	744.7	759.3	764.9	755.8	739.9	734.7
G27.0	777.8	769.0	746.2	730.8	735.7	751.4	757.7	748.4	730.6	724.9
G28.0	771.4	762.3	738.2	722.2	727.1	744.3	751.0	741.0	722.5	716.0
G29.0	765.3	755.2	730.1	712.9	718.2	736.9	744.3	733.3	713.5	706.8
G30.0	757.7	746.9	720.6	702.8	708.8	728.1	736.2	724.8	703.9	696.8
G31.0	751.2	739.7	711.5	693.0	699.7	720.3	729.1	717.1	695.0	687.1
G32.0	743.8	731.3	701.7	682.4	689.5	711.5	721.0	707.9	684.5	676.0
G33.0	736.5	723.8	692.8	672.8	680.0	703.4	713.1	699.4	674.6	666.1
G34.0	729.4	715.6	683.2	662.2	670.0	694.6	704.8	690.9	664.9	655.1
G35.0	721.0	706.8	673.0	651.1	659.5	685.6	696.3	681.6	653.9	643.8
G36.0	713.2	697.9	662.8	640.1	649.3	676.4	687.7	672.8	643.8	633.2

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C30.0	C60.0	C90.0	C120.0	C150.0	C180.0	C210.0	C240.0	C270.0
G37.0	705.0	689.9	652.7	629.5	639.0	667.7	678.3	662.8	632.4	621.6
G38.0	696.2	680.2	641.3	617.3	627.4	657.1	670.0	653.6	622.3	610.0
G39.0	687.6	671.3	631.4	606.2	617.0	648.1	660.8	644.0	612.0	599.4
G40.0	678.2	661.1	619.4	593.7	605.0	637.4	651.2	633.7	600.0	586.7
G41.0	669.4	652.1	609.0	582.0	594.3	627.8	641.7	623.7	589.2	575.4
G42.0	660.7	642.3	597.9	570.4	583.0	617.7	632.5	614.2	577.7	563.5
G43.0	650.6	631.9	586.1	558.0	570.7	607.0	622.4	603.2	566.0	550.8
G44.0	641.5	621.9	574.7	545.7	559.3	596.5	612.7	592.6	554.7	539.3
G45.0	631.9	612.4	563.1	533.6	548.0	586.6	602.0	581.7	542.1	525.6
G46.0	621.5	600.8	551.1	520.7	535.0	575.0	592.0	571.4	530.8	514.0
G47.0	611.6	590.8	539.3	508.5	523.6	564.8	582.1	561.1	519.0	501.4
G48.0	601.0	579.3	526.9	494.9	510.5	552.9	570.7	549.2	506.0	488.2
G49.0	590.7	569.1	515.7	482.5	499.2	542.4	560.9	538.8	494.4	475.7
G50.0	581.2	558.4	503.5	470.1	486.7	531.5	550.7	527.8	483.1	463.2
G51.0	569.9	546.8	490.5	456.0	474.3	519.9	539.8	516.3	469.9	449.6
G52.0	560.0	535.9	478.8	443.7	462.0	508.9	529.2	505.8	458.2	437.5
G53.0	549.8	525.3	466.6	430.8	449.8	498.2	518.0	493.7	444.9	423.4
G54.0	538.0	513.4	453.9	417.1	436.7	486.0	507.9	483.2	433.4	411.0
G55.0	528.0	502.9	441.5	404.2	424.4	475.6	497.0	472.2	421.2	398.8
G56.0	516.6	490.8	428.6	390.4	411.6	463.6	485.2	460.7	408.3	384.2
G57.0	505.9	480.2	416.1	377.8	399.7	452.9	474.8	449.6	396.6	371.3
G58.0	495.2	469.0	403.9	364.1	386.7	441.2	464.5	438.9	384.4	359.0
G59.0	483.4	457.0	390.6	350.6	374.0	429.6	452.9	426.8	370.8	344.8
G60.0	472.9	445.7	378.6	337.6	361.3	418.4	442.6	416.2	359.4	332.4
G61.0	461.1	434.1	365.2	323.8	348.8	406.8	430.8	404.6	346.6	318.8
G62.0	450.4	423.0	353.7	310.9	336.4	395.9	420.5	393.4	334.4	306.0
G63.0	440.0	411.8	341.4	297.6	324.3	385.2	409.9	383.1	322.8	293.6
G64.0	428.0	400.3	328.6	284.4	311.7	373.2	398.7	371.3	310.3	279.7
G65.0	417.9	389.7	316.4	271.4	300.0	362.8	388.7	361.1	298.6	267.4
G66.0	407.1	378.5	304.9	259.3	288.0	352.0	378.1	350.2	287.0	254.8
G67.0	395.9	366.7	292.2	245.7	275.5	340.8	366.9	339.2	275.1	241.8
G68.0	385.2	356.3	281.1	233.3	264.4	330.2	356.5	329.1	264.3	229.7
G69.0	374.1	344.9	268.5	219.5	251.9	319.1	345.8	317.6	252.1	216.3
G70.0	363.3	334.3	257.2	207.7	241.3	308.6	336.0	307.8	241.5	204.7
G71.0	353.4	323.7	246.4	195.5	230.3	298.4	325.9	297.6	231.2	192.9
G72.0	341.9	312.6	234.4	182.1	219.1	287.9	315.5	287.1	219.4	179.7
G73.0	332.1	302.2	223.9	170.7	208.3	277.8	305.5	277.6	209.4	168.6

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C30.0	C60.0	C90.0	C120.0	C150.0	C180.0	C210.0	C240.0	C270.0
G74.0	322.1	292.3	213.8	158.8	198.0	268.3	296.1	267.8	199.1	156.9
G75.0	311.5	281.0	202.1	146.7	186.8	257.8	285.6	257.8	188.5	144.8
G76.0	301.6	271.7	192.4	135.2	177.1	248.5	276.5	248.1	178.7	133.5
G77.0	291.4	260.8	181.5	123.6	166.7	238.2	266.3	238.3	168.2	122.2
G78.0	281.8	251.7	171.5	112.6	157.4	229.4	257.6	229.2	159.3	111.2
G79.0	272.5	242.1	162.3	102.3	148.1	220.2	248.7	220.6	150.1	101.1
G80.0	262.4	232.0	152.0	90.7	138.7	211.2	239.1	211.2	140.9	89.8
G81.0	253.5	223.0	143.3	81.2	129.9	202.5	230.3	202.8	132.6	80.2
G82.0	244.5	213.8	134.3	71.2	121.5	193.9	221.5	193.7	123.5	69.6
G83.0	235.1	204.5	125.3	61.0	112.8	185.2	213.1	186.0	115.9	60.7
G84.0	226.4	196.4	116.8	51.6	105.2	177.4	205.1	177.7	108.2	51.5
G85.0	216.9	187.1	108.2	43.1	97.0	168.8	196.1	169.8	100.3	43.1
G86.0	208.9	179.2	100.6	33.9	90.0	160.9	188.5	161.8	93.2	33.9
G87.0	200.7	171.2	93.3	25.9	83.2	153.7	180.5	154.4	86.5	26.0
G88.0	192.3	162.8	86.4	17.5	76.1	145.6	172.4	146.5	79.7	17.8
G89.0	184.4	155.1	78.9	10.9	69.7	138.6	164.8	139.5	73.6	11.3
G90.0	176.7	147.7	72.0	6.6	63.4	131.8	157.2	132.1	67.1	7.6
G91.0	168.8	139.4	65.0	5.6	57.1	124.2	150.3	125.4	61.3	6.8
G92.0	160.9	132.5	58.1	4.9	51.7	117.8	142.9	118.9	55.8	6.2
G93.0	152.7	124.4	50.9	4.2	45.6	110.8	135.9	112.1	50.5	5.7
G94.0	144.9	117.4	44.7	3.9	41.0	104.9	129.2	106.1	46.5	5.3
G95.0	137.6	110.3	39.7	3.5	36.2	98.9	122.7	100.3	43.0	4.9
G96.0	129.4	103.2	35.5	3.3	33.2	93.5	116.4	94.7	39.5	4.6
G97.0	122.7	96.7	32.7	3.3	32.3	88.7	111.0	90.3	36.5	4.3
G98.0	115.8	91.4	30.2	3.5	30.2	84.7	105.9	85.9	33.4	4.1
G99.0	109.6	85.9	27.9	3.6	27.5	79.7	101.1	81.6	30.9	4.1
G100.0	104.6	82.4	25.6	3.7	25.3	75.2	96.6	77.4	28.5	4.2
G101.0	99.7	77.8	23.4	3.9	22.9	69.8	91.8	73.3	26.4	4.3
G102.0	95.2	73.9	21.2	4.0	21.2	65.2	87.4	69.6	24.3	4.4
G103.0	90.9	70.0	19.5	4.1	19.3	61.1	83.8	65.9	22.4	4.5
G104.0	86.4	66.1	17.6	4.3	17.5	57.9	79.3	62.1	20.6	4.8
G105.0	82.5	62.6	16.3	4.4	16.1	54.7	75.3	58.6	18.9	4.8
G106.0	78.2	58.9	15.1	4.5	14.6	51.3	71.3	55.2	17.2	4.9
G107.0	74.2	55.6	14.1	4.6	13.3	48.1	67.5	52.1	15.8	5.1
G108.0	70.5	52.4	13.3	4.8	12.1	44.0	63.8	49.2	14.4	5.2
G109.0	66.4	49.3	12.3	4.9	10.7	41.4	60.4	46.1	13.0	5.4
G110.0	63.0	46.4	11.3	5.1	9.7	38.8	57.1	42.8	11.8	5.5

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C30.0	C60.0	C90.0	C120.0	C150.0	C180.0	C210.0	C240.0	C270.0
G111.0	59.5	43.4	10.3	5.2	8.6	37.0	54.1	41.1	10.6	5.6
G112.0	56.1	41.0	9.3	5.3	7.8	35.4	50.8	38.1	9.7	5.8
G113.0	53.0	38.4	8.5	5.5	7.4	33.1	48.0	35.5	8.8	5.8
G114.0	49.8	35.9	7.8	5.5	7.4	29.1	44.8	30.7	8.5	6.1
G115.0	46.8	33.5	7.4	5.7	7.5	26.7	42.3	28.3	8.5	6.2
G116.0	44.1	31.0	7.2	5.8	7.5	24.9	39.8	26.0	8.5	6.4
G117.0	42.1	26.6	7.3	6.0	7.6	22.7	36.8	23.8	8.5	6.5
G118.0	38.7	24.5	7.4	6.2	7.6	21.3	34.4	22.0	8.4	6.7
G119.0	36.0	22.4	7.4	6.3	7.7	19.7	32.0	20.4	8.4	6.8
G120.0	33.4	20.5	7.5	6.4	7.9	17.9	29.6	18.7	8.5	7.0
G121.0	31.1	18.7	7.5	6.6	7.8	16.4	27.5	17.2	8.5	7.1
G122.0	28.6	17.2	7.7	6.8	8.0	15.1	25.4	15.8	8.5	7.3
G123.0	26.7	15.7	7.7	7.0	8.0	14.0	23.2	14.5	8.7	7.5
G124.0	24.5	14.6	7.8	7.1	8.1	12.9	21.3	13.4	8.6	7.6
G125.0	22.3	13.4	7.9	7.2	8.2	11.8	19.4	12.3	8.8	7.7
G126.0	20.8	12.3	8.1	7.4	8.3	11.0	17.7	11.3	8.8	7.9
G127.0	18.7	11.4	8.1	7.5	8.3	10.5	16.0	10.8	8.9	8.0
G128.0	16.9	10.5	8.2	7.7	8.4	10.5	14.6	10.6	8.9	8.2
G129.0	15.4	10.1	8.3	7.8	8.5	10.5	13.4	10.7	9.0	8.3
G130.0	13.9	10.0	8.5	8.0	8.7	10.4	12.1	10.7	9.2	8.4
G131.0	12.6	10.0	8.5	8.1	8.7	10.5	11.6	10.8	9.2	8.6
G132.0	11.6	10.0	8.5	8.2	8.9	10.4	11.7	10.7	9.3	8.6
G133.0	11.2	10.2	8.7	8.2	8.9	10.6	11.7	10.8	9.4	8.8
G134.0	11.3	10.1	8.8	8.5	9.1	10.7	11.8	10.9	9.5	9.1
G135.0	11.3	10.3	8.9	8.6	9.2	10.6	11.7	10.9	9.6	9.1
G136.0	11.4	10.3	9.0	8.8	9.3	10.6	11.8	11.0	9.7	9.2
G137.0	11.4	10.4	9.2	8.9	9.4	10.6	11.8	11.1	9.8	9.4
G138.0	11.5	10.5	9.2	9.0	9.5	10.6	11.9	11.2	9.9	9.5
G139.0	11.4	10.6	9.3	9.1	9.5	10.7	11.9	11.3	9.9	9.6
G140.0	11.5	10.7	9.5	9.2	9.7	10.8	11.9	11.4	10.2	9.7
G141.0	11.5	10.8	9.6	9.4	9.7	10.9	12.0	11.4	10.2	9.8
G142.0	11.6	10.8	9.8	9.5	9.9	11.0	12.0	11.5	10.4	10.0
G143.0	11.6	10.9	9.8	9.7	10.0	11.0	12.1	11.5	10.4	10.2
G144.0	11.6	11.1	9.9	9.8	10.1	11.2	12.1	11.6	10.5	10.2
G145.0	11.7	11.1	10.1	9.9	10.3	11.2	12.1	11.7	10.7	10.4
G146.0	11.8	11.1	10.2	10.0	10.3	11.3	12.1	11.8	10.8	10.5
G147.0	11.8	11.2	10.4	10.2	10.5	11.4	12.2	11.8	10.8	10.5

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C30.0	C60.0	C90.0	C120.0	C150.0	C180.0	C210.0	C240.0	C270.0
G148.0	11.8	11.4	10.4	10.3	10.5	11.4	12.2	11.8	11.0	10.7
G149.0	11.8	11.3	10.5	10.5	10.7	11.5	12.2	11.9	11.1	10.9
G150.0	11.8	11.4	10.7	10.6	10.8	11.7	12.2	12.0	11.1	10.8
G151.0	11.8	11.5	10.8	10.7	10.9	11.8	12.2	12.0	11.2	11.0
G152.0	11.9	11.5	10.8	10.8	11.0	11.8	12.2	12.0	11.3	11.1
G153.0	12.0	11.6	11.0	11.0	11.0	11.9	12.2	12.1	11.4	11.1
G154.0	12.0	11.6	11.1	11.1	11.1	12.0	12.3	12.2	11.5	11.3
G155.0	12.0	11.7	11.2	11.2	11.2	11.9	12.3	12.2	11.5	11.4
G156.0	12.0	11.7	11.3	11.3	11.4	12.0	12.3	12.2	11.6	11.5
G157.0	12.1	11.8	11.4	11.4	11.4	12.1	12.4	12.3	11.7	11.6
G158.0	12.1	11.8	11.4	11.5	11.5	12.1	12.3	12.3	11.8	11.7
G159.0	12.1	11.9	11.5	11.6	11.5	12.2	12.3	12.4	11.7	11.7
G160.0	12.1	11.9	11.7	11.7	11.6	12.2	12.3	12.4	11.8	11.8
G161.0	12.1	12.0	11.7	11.8	11.5	12.2	12.4	12.4	11.8	11.9
G162.0	12.2	12.0	11.8	11.9	11.6	12.2	12.4	12.4	11.9	12.0
G163.0	12.2	12.1	11.9	12.0	11.7	12.3	12.4	12.4	12.0	12.1
G164.0	12.2	12.2	12.0	12.0	11.8	12.3	12.4	12.5	12.1	12.2
G165.0	12.3	12.2	12.1	12.1	11.9	12.3	12.5	12.4	12.1	12.2
G166.0	12.3	12.2	12.2	12.2	11.9	12.4	12.5	12.5	12.2	12.3
G167.0	12.3	12.3	12.2	12.2	12.0	12.3	12.5	12.5	12.3	12.4
G168.0	12.4	12.4	12.3	12.4	12.1	12.4	12.5	12.5	12.3	12.4
G169.0	12.5	12.4	12.3	12.4	12.1	12.4	12.6	12.5	12.4	12.6
G170.0	12.5	12.5	12.4	12.5	12.2	12.4	12.6	12.5	12.5	12.7
G171.0	12.5	12.5	12.4	12.6	12.2	12.4	12.7	12.5	12.5	12.8
G172.0	12.6	12.6	12.4	12.7	12.4	12.4	12.7	12.5	12.6	12.8
G173.0	12.6	12.6	12.4	12.7	12.4	12.3	12.7	12.5	12.6	12.9
G174.0	12.6	12.6	12.5	12.9	12.5	12.3	12.8	12.5	12.7	12.9
G175.0	12.7	12.7	12.6	12.9	12.7	12.3	12.8	12.6	12.8	13.0
G176.0	12.7	12.7	12.7	13.0	12.8	12.4	12.8	12.7	13.0	13.0
G177.0	12.9	12.7	12.8	13.0	12.9	12.6	12.9	12.9	13.1	13.1
G178.0	12.8	12.9	13.0	13.0	13.1	12.8	13.0	13.1	13.2	13.1
G179.0	12.9	13.0	13.0	13.1	13.1	13.0	13.2	13.2	13.1	13.2
G180.0	13.1	13.1	13.0	13.1	13.1	13.0	13.2	13.2	13.2	13.1

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector:

Candlepower Table (Continue 5)

Unit: cd

G\C	C300.0	C330.0	C360.0							
G0.0	859.1	859.1	859.1							
G1.0	859.3	859.2	859.4							
G2.0	859.0	859.2	859.1							
G3.0	858.1	858.6	859.2							
G4.0	857.1	858.1	858.6							
G5.0	855.4	857.1	857.9							
G6.0	853.6	855.7	856.9							
G7.0	851.6	854.1	855.7							
G8.0	848.9	851.8	854.3							
G9.0	846.0	849.5	852.4							
G10.0	842.8	847.6	850.3							
G11.0	839.1	844.4	848.1							
G12.0	835.2	841.5	845.4							
G13.0	831.2	838.4	842.7							
G14.0	826.4	834.7	839.6							
G15.0	821.8	830.7	836.4							
G16.0	816.4	826.2	832.5							
G17.0	811.2	822.2	828.8							
G18.0	805.7	817.6	825.1							
G19.0	799.0	812.2	820.7							
G20.0	792.7	807.3	816.2							
G21.0	786.1	801.8	811.6							
G22.0	779.0	796.0	806.3							
G23.0	772.2	789.8	801.5							
G24.0	763.8	783.5	795.5							
G25.0	756.4	777.5	790.1							
G26.0	748.4	770.6	784.1							
G27.0	739.8	763.3	777.8							
G28.0	731.5	756.5	771.4							
G29.0	722.8	749.0	765.3							
G30.0	713.5	741.4	757.7							
G31.0	704.2	733.6	751.2							
G32.0	694.3	725.3	743.8							
G33.0	684.7	717.0	736.5							
G34.0	674.9	708.4	729.4							
G35.0	664.4	699.3	721.0							
G36.0	654.5	691.0	713.2							

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector:

Candlepower Table (Continue 6)

Unit: cd

G\C	C300.0	C330.0	C360.0							
G37.0	643.2	681.2	705.0							
G38.0	632.8	672.6	696.2							
G39.0	622.1	663.1	687.6							
G40.0	610.3	653.4	678.2							
G41.0	599.3	643.7	669.4							
G42.0	588.7	634.1	660.7							
G43.0	576.9	623.8	650.6							
G44.0	565.3	613.6	641.5							
G45.0	553.0	602.6	631.9							
G46.0	541.8	592.3	621.5							
G47.0	530.0	582.1	611.6							
G48.0	516.9	570.3	601.0							
G49.0	505.7	560.1	590.7							
G50.0	493.4	549.2	581.2							
G51.0	480.8	537.7	569.9							
G52.0	469.3	527.2	560.0							
G53.0	455.9	514.8	549.8							
G54.0	444.2	504.2	538.0							
G55.0	431.8	493.2	528.0							
G56.0	419.0	481.5	516.6							
G57.0	406.6	470.5	505.9							
G58.0	394.8	459.8	495.2							
G59.0	381.4	447.5	483.4							
G60.0	369.7	437.0	472.9							
G61.0	356.1	424.8	461.1							
G62.0	344.5	414.0	450.4							
G63.0	332.1	402.8	440.0							
G64.0	319.5	391.2	428.0							
G65.0	307.9	380.5	417.9							
G66.0	295.9	369.6	407.1							
G67.0	283.6	358.1	395.9							
G68.0	272.4	347.3	385.2							
G69.0	259.9	336.0	374.1							
G70.0	249.0	326.0	363.3							
G71.0	237.9	315.1	353.4							
G72.0	226.4	304.2	341.9							
G73.0	216.0	293.8	332.1							

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector:

Candlepower Table (Continue 7)

Unit: cd

G\C	C300.0	C330.0	C360.0							
G74.0	205.5	284.1	322.1							
G75.0	194.0	272.8	311.5							
G76.0	184.1	263.4	301.6							
G77.0	173.4	252.8	291.4							
G78.0	163.8	243.5	281.8							
G79.0	154.7	234.2	272.5							
G80.0	144.5	224.4	262.4							
G81.0	135.3	215.2	253.5							
G82.0	126.1	205.7	244.5							
G83.0	117.7	197.4	235.1							
G84.0	109.6	188.8	226.4							
G85.0	101.0	179.7	216.9							
G86.0	93.6	172.1	208.9							
G87.0	86.7	163.9	200.7							
G88.0	78.9	155.8	192.3							
G89.0	72.1	148.5	184.4							
G90.0	65.0	140.1	176.7							
G91.0	58.8	132.8	168.8							
G92.0	52.4	125.4	160.9							
G93.0	45.6	117.1	152.7							
G94.0	40.4	109.7	144.9							
G95.0	36.2	102.6	137.6							
G96.0	32.1	94.7	129.4							
G97.0	29.0	87.9	122.7							
G98.0	25.9	82.8	115.8							
G99.0	23.6	78.3	109.6							
G100.0	21.5	74.1	104.6							
G101.0	19.4	70.1	99.7							
G102.0	17.6	66.4	95.2							
G103.0	15.9	63.0	90.9							
G104.0	14.4	59.6	86.4							
G105.0	13.6	56.4	82.5							
G106.0	12.7	53.4	78.2							
G107.0	12.0	50.7	74.2							
G108.0	11.1	48.3	70.5							
G109.0	10.1	45.5	66.4							
G110.0	9.4	43.7	63.0							

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector:

Candlepower Table (Continue 8)

Unit: cd

G\C	C300.0	C330.0	C360.0							
G111.0	8.7	41.0	59.5							
G112.0	7.9	38.3	56.1							
G113.0	7.3	36.0	53.0							
G114.0	7.2	33.5	49.8							
G115.0	7.2	31.2	46.8							
G116.0	7.3	27.7	44.1							
G117.0	7.3	25.0	42.1							
G118.0	7.4	22.9	38.7							
G119.0	7.5	21.0	36.0							
G120.0	7.7	19.1	33.4							
G121.0	7.7	17.7	31.1							
G122.0	7.8	16.2	28.6							
G123.0	7.9	14.7	26.7							
G124.0	8.0	13.5	24.5							
G125.0	8.1	12.4	22.3							
G126.0	8.2	11.5	20.8							
G127.0	8.3	10.6	18.7							
G128.0	8.4	10.2	16.9							
G129.0	8.5	10.3	15.4							
G130.0	8.7	10.3	13.9							
G131.0	8.8	10.3	12.6							
G132.0	8.8	10.3	11.6							
G133.0	9.0	10.3	11.2							
G134.0	9.1	10.4	11.3							
G135.0	9.1	10.6	11.3							
G136.0	9.2	10.6	11.4							
G137.0	9.4	10.6	11.4							
G138.0	9.5	10.7	11.5							
G139.0	9.5	10.8	11.4							
G140.0	9.7	10.8	11.5							
G141.0	9.9	11.0	11.5							
G142.0	9.9	11.0	11.6							
G143.0	10.2	11.1	11.6							
G144.0	10.2	11.2	11.6							
G145.0	10.3	11.3	11.7							
G146.0	10.4	11.4	11.8							
G147.0	10.5	11.4	11.8							

C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 9.010 m
Humidity:
Inspector:

Candlepower Table (Continue 9)

Unit: cd

G\C	C300.0	C330.0	C360.0							
G148.0	10.6	11.5	11.8							
G149.0	10.8	11.5	11.8							
G150.0	10.8	11.6	11.8							
G151.0	11.0	11.7	11.8							
G152.0	11.1	11.7	11.9							
G153.0	11.1	11.7	12.0							
G154.0	11.3	11.8	12.0							
G155.0	11.4	11.9	12.0							
G156.0	11.5	11.9	12.0							
G157.0	11.6	11.9	12.1							
G158.0	11.7	12.0	12.1							
G159.0	11.8	12.1	12.1							
G160.0	11.8	12.2	12.1							
G161.0	11.9	12.2	12.1							
G162.0	12.0	12.3	12.2							
G163.0	12.1	12.3	12.2							
G164.0	12.2	12.3	12.2							
G165.0	12.3	12.4	12.3							
G166.0	12.3	12.4	12.3							
G167.0	12.4	12.5	12.3							
G168.0	12.5	12.6	12.4							
G169.0	12.5	12.6	12.5							
G170.0	12.5	12.6	12.5							
G171.0	12.6	12.7	12.5							
G172.0	12.6	12.7	12.6							
G173.0	12.7	12.7	12.6							
G174.0	12.7	12.7	12.6							
G175.0	12.9	12.8	12.7							
G176.0	12.9	12.8	12.7							
G177.0	13.0	12.9	12.9							
G178.0	13.0	13.0	12.8							
G179.0	13.2	13.1	12.9							
G180.0	13.2	13.2	13.1							

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 9.010 m

Humidity:

Inspector: